


100mm Dual Hydrant Booster & Feed Assembly-WA

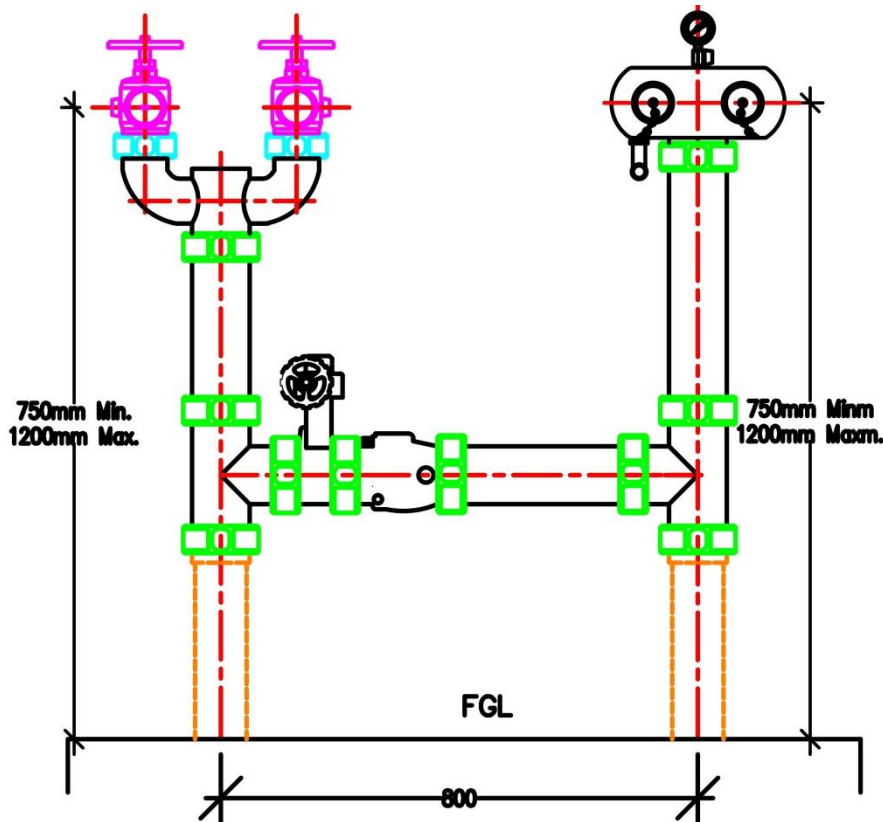

PRODUCT CODE

- 1] 100WDBFHBI WA DUAL BOOSTER & FEED HYDRANT GROOVED END WITH BI
- 2] 100WDBFHBIFL WA DUAL BOOSTER & FEED HYDRANT FLANGED END WITH BI

APPROVALS

- 1] Comply to - AS 2419
- 2] Full Flow Check Valve- UL/FM Approved
- 3] Butter Fly Valve - UL/FM Approved & Water Marked
- 4] Booster Head - AS 2419.3-2012 & Water Marked
- 5] Hydrant Valves - AS 2419.2-2009 & Water Marked
- 6] Pipe - Hot Dip Galvanized
- 7] R/G Couplings - UL/FM Approved

WORKING PRESSURE

- 1] Full Flow Check Valve - 2068 kPa
- 2] Butter Fly Valve - 2068 kPa
- 3] Booster Head - 1400 kPa
- 4] Hydrant Valves - 1850 kPa
- 5] R/G Couplings - 2068 kPa



AVAILABLE OPTIONS

- 1] Butter Fly Valve installed under Booster Head where head pressure is greater than 50 kPa.